

CITY OF NORTHPORT  
ELECTRICAL PERMIT APPLICATION

*If you are applying for a mobile home electrical service, a septic tank approval will be required from the County Health Department before electrical service is rendered unless located in an approved mobile home park.*

*Section 22-206(b) of the Northport Code of Ordinance allows a homeowner to install or maintain the electrical system in or on his own premises, which he himself owns and occupies. Otherwise a certified electrician, licensed by the City of Northport will be required.*

Date: \_\_\_\_\_ Permit #: \_\_\_\_\_

Phone #: \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Directions: \_\_\_\_\_

Electrical Work By: \_\_\_\_\_

**Check One:**

Trailer Park:           yes           no

City Limits           Police Jurisdiction

Septic Tank Approved:    yes           no


\_\_\_\_\_  
Signature of Owner

- FEES:** RESIDENTIAL TRAILER SERVICE (10.00)
- RESIDENTIAL UP-GRADE (10.00)
- COMMERCIAL SERVICE (15.00)
- COMMERCIAL UP-GRADE (15.00)

CHECK #:

CASH:

Planning Dept Approval: \_\_\_\_\_

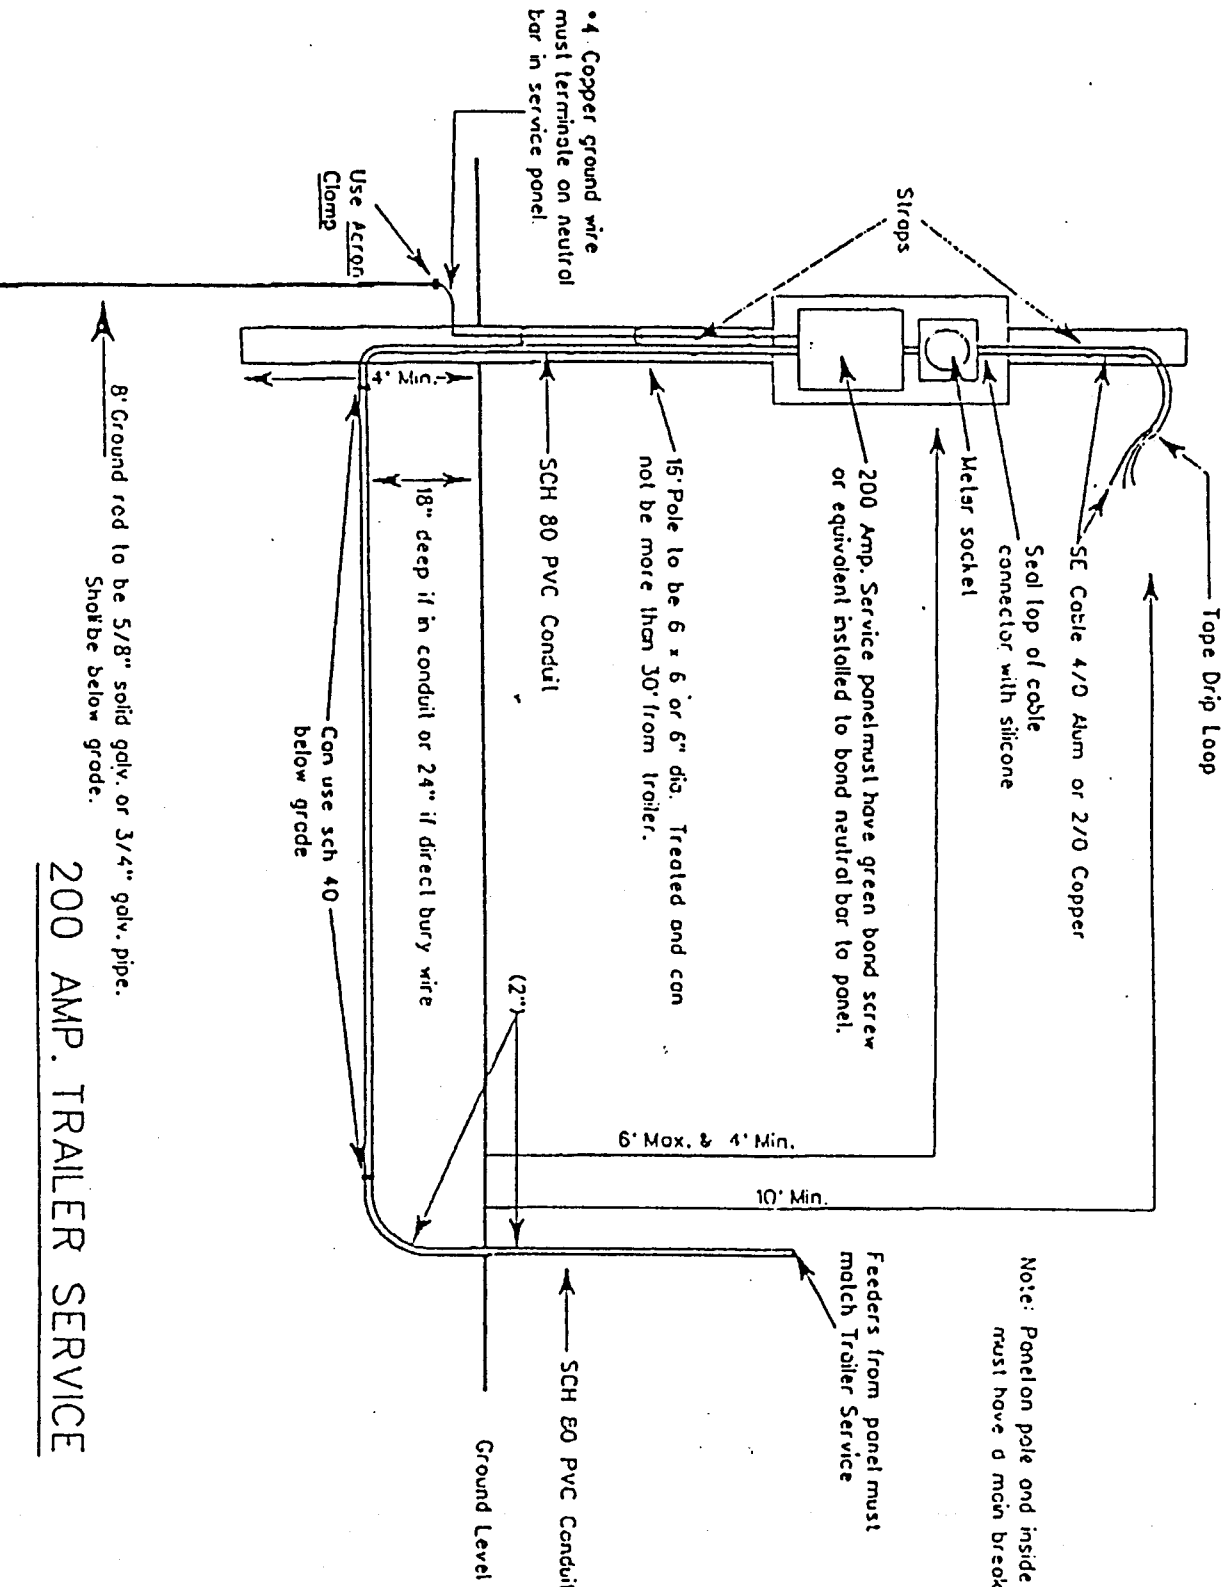

\* 4. Copper ground wire must terminate on neutral bar in service panel.

Straps

Top Drip Loop

SE Cable 4/0 Alum or 2/0 Copper

Seal top of cable connector with silicone

Meter socket

200 Amp. Service panel must have green bond screw or equivalent installed to bond neutral bar to panel.

15' Pole to be 6 x 6 or 6" dia. Treated and can not be more than 30' from trailer.

SCH 80 PVC Conduit

18" deep if in conduit or 24" if direct bury wire

Can use sch 40 below grade

6' Max. & 4' Min.

10' Min.

Feeders from panel must match Trailer Service

SCH 80 PVC Conduit

Ground Level

Note: Panel pole and inside trailer must have a main breaker.

Use Acron Clamp

8' Ground rod to be 5/8" solid galv. or 3/4" galv. pipe. Snake below grade.

200 AMP. TRAILER SERVICE